

JUMO GmbH & Co. KG
 Delivery address: Mackenrodtstraße 14
 36039 Fulda, Germany
 Postal address: 36035 Fulda, Germany
 Phone: +49 661 6003-0
 Fax: +49 661 6003-607
 Email: mail@jumo.net
 Internet: www.jumo.net

JUMO Instrument Co. Ltd.
 JUMO House
 Temple Bank, Riverway
 Harlow, Essex, CM20 2DY, UK
 Phone: +44 1279 63 55 33
 Fax: +44 1279 62 50 29
 Email: sales@jumo.co.uk
 Internet: www.jumo.co.uk

JUMO Process Control, Inc.
 6733 Myers Road
 East Syracuse, NY 13057, USA
 Phone: +1 315 437 5866
 Fax: +1 315 437 5860
 Email: info.us@jumo.net
 Internet: www.jumousa.com



Pressure and differential pressure switch for air, smoke and flue gases

Adjustment range from 0.4 to 150 mbar

Brief description

Pressure and differential pressure switches Type 4 ADS are used to measure vacuum, pressure or differential pressure in HVAC and filter technology, for example. Pressure and differential pressure switches consist essentially of base, diaphragm, intermediate disc, case and protective cover. When used as pressure or vacuum switch, the base and diaphragm with disc form the pressure chamber.

When used as a differential pressure switch, the base and a second diaphragm with intermediate disc form the two pressure chambers. A pressure change in the pressure chamber causes an axial displacement of a pin linked to the diaphragm. When the selected switching point is reached, a spring-loaded contact is activated.



Type 4 ADS-82

Technical data

Case

Polycarbonate

Parts in contact with medium

Polycarbonate

Diaphragm

NBR

Pressure connection

2× tubing nipple 4.6 mm dia.

Cable entry

Pg11

Electrical connection

screw terminals for up to 2.5 mm² conductor cross-section

Type of contact

single-pole as changeover switch

fine silver (Ag)

Protection

IP54

Adjustment ranges, differential

Adjustment range mbar	Differential Δp in mbar
0.4 to 3	≤ 0.3
1 to 10	≤ 0.5
2.5 to 50	≤ 1.5
30 to 150	≤ 5

Max. operating pressure

0 to 500 mbar

Switching point accuracy

The setpoint indicated on the scale conforms to the actual value with a tolerance of $\pm 15\%$.

Rating

AC 50 to 60 Hz, 250 V, 6 A, $\varphi = 1$
 AC 50 to 60 Hz, 250 V, 3 A, $\varphi = 0.6$

Permissible ambient temperature and temperature of medium

-15 to +60 °C

Switching function with rising pressure

1 n.c. opening, 2 n.o. closing

Switching function with falling pressure

1 n.c. closing, 2 n.o. opening

Operating position

The standard operating position is with the diaphragm standing vertically; with horizontal face-up mounting, the pressure monitor switches when the pressure is about 0.5 mbar higher.

With horizontal face-down mounting, the pressure monitor switches when the pressure is about 0.5 mbar lower.


In an intermediate position, the pressure monitor will switch at a pressure that deviates by a maximum of ± 0.5 mbar from the selected setpoint.

Accessories

HVAC installation kit, consisting of:

- 2 tube connections
- 6 self-tapping screws
- 2 extension tubes
- 1 jig
- 1 fixing bracket

Electrical connection

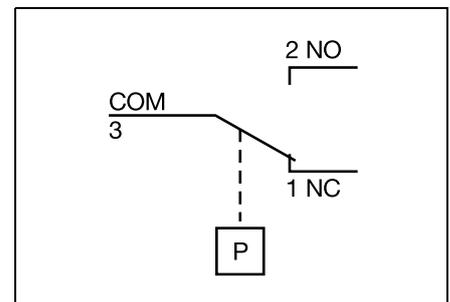


JUMO GmbH & Co. KG
 Delivery address: Mackenrodtstraße 14
 36039 Fulda, Germany
 Postal address: 36035 Fulda, Germany
 Phone: +49 661 6003-0
 Fax: +49 661 6003-607
 Email: mail@jumo.net
 Internet: www.jumo.net

JUMO Instrument Co. Ltd.
 JUMO House
 Temple Bank, Riverway
 Harlow, Essex, CM20 2DY, UK
 Phone: +44 1279 63 55 33
 Fax: +44 1279 62 50 29
 Email: sales@jumo.co.uk
 Internet: www.jumo.co.uk

JUMO Process Control, Inc.
 6733 Myers Road
 East Syracuse, NY 13057, USA
 Phone: +1 315 437 5866
 Fax: +1 315 437 5860
 Email: info.us@jumo.net
 Internet: www.jumousa.com



Dimensions

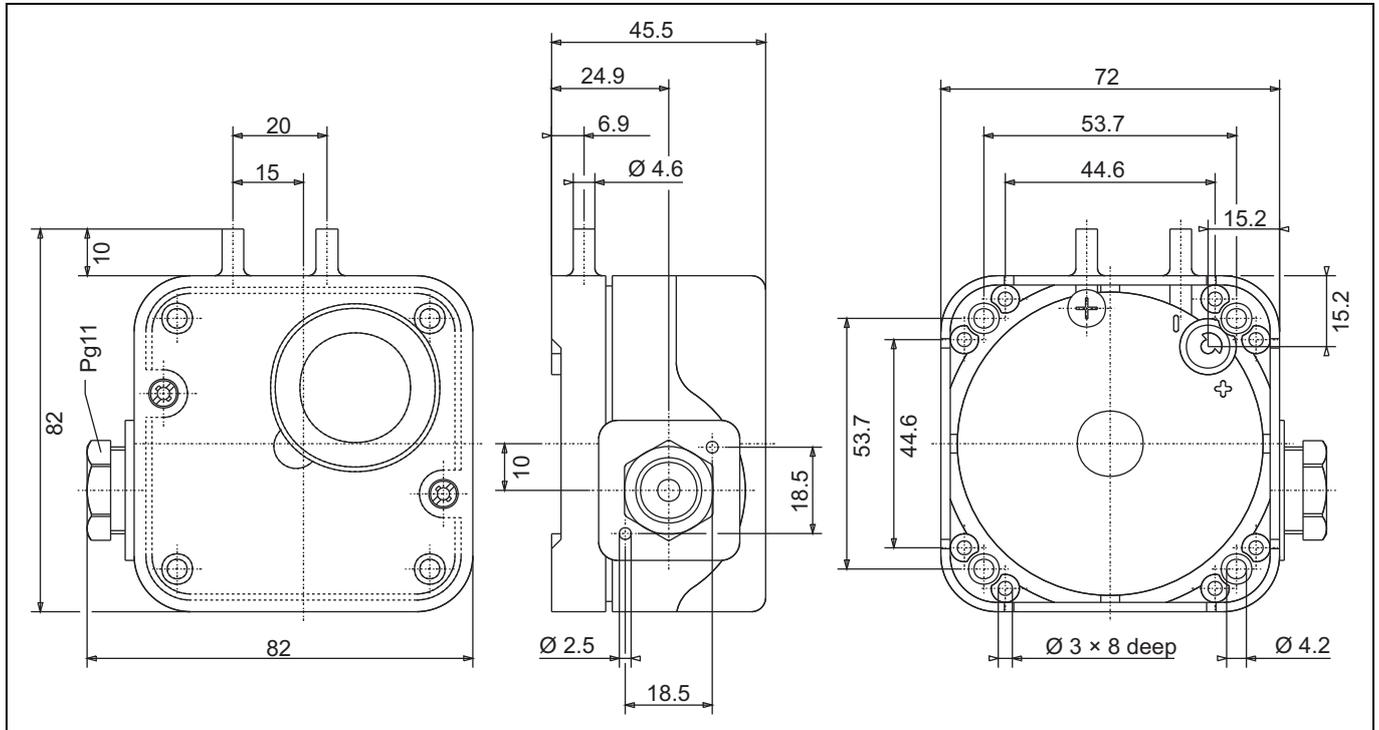

Order details

(1) Basic version	
4 ADS-82	Pressure and differential pressure switch for air, smoke and flue gases in surface-mounted case 82 mm × 82 mm

Order code
 Order example 4 ADS-82

Accessories

Designation	Part no.
HVAC installation kit: Pressure and differential pressure switch for air and smoke	00381238